



TOP VIEW

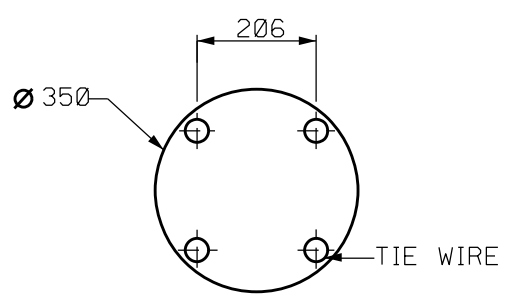

REBAR PLAN

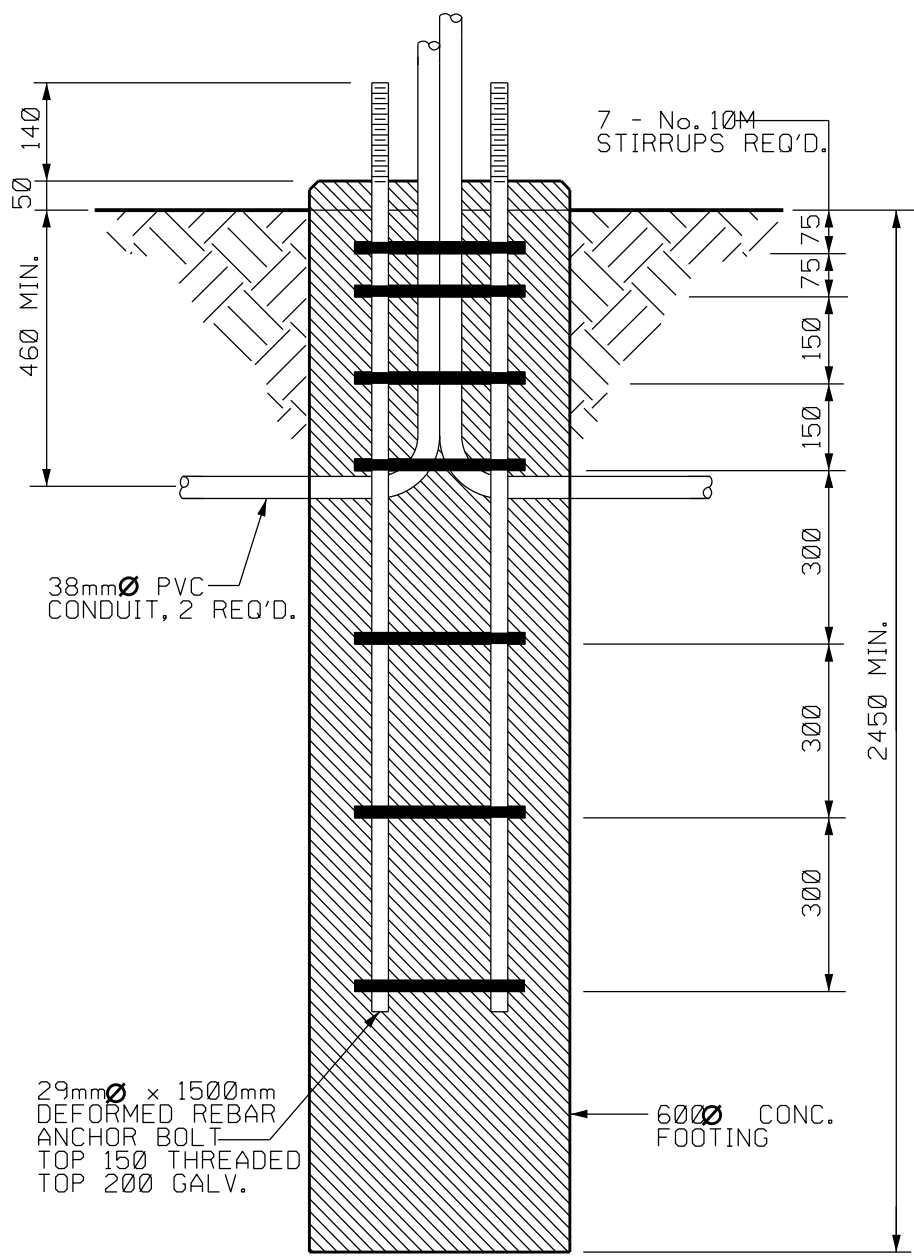


SIDE VIEW

NOTES:

1. CEMENT SHALL BE ALKALI-SULFATE RESISTANT TYPE.
2. CONCRETE SHALL HAVE A CLASS 1 FINISH.
3. (a) THE ULTIMATE COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 25.9 MPa AT 28 DAYS.
 (b) AIR CONTENT OF CONCRETE TO BE 3%-4%.
 (c) CONCRETE SLUMP SHALL BE 75-100mm.
 (d) MAXIMUM SIZE OF COARSE AGGREGATE IS 25mm.
4. DEPTH OF BASE TO BE SPECIFIED BY ENGINEER.
5. BASE LOCATION MUST BE STAKED BY THE ENGINEER.
6. ALL BASES SHALL BE 50mm ABOVE GRADE c/w 25mm CHAMFERED EDGE UNLESS OTHERWISE SPECIFIED BY THE ENGINEER.
7. ALL MEASUREMENTS IN MILLIMETERS.
8. CONCRETE VOLUME 0.73 m³.

REVISIONS	DATE	DESCRIPTION	BY
08-08		REVISIONS	DC

Manitoba 
 Infrastructure and Transportation
 TRAFFIC ENGINEERING

STANDARD BASE
 FOR APRON LIGHTING

APPROVED BY: LUCIEN GAGNON

SCALE: N.T.S.
 DATE: 06/03
 PREP. BY: D.C.
 E-001a