

3. The Applicant shall operate the chlorination unit of the said sewage treatment plant on a continuous basis in such a manner as to maintain at all times a measurable chlorine residual in the effluent.

4. The Applicant shall
 - (a) measure the residual chlorine content of the effluent from the said sewage treatment plant;


 - (b) record the measured residual chlorine content;

 - (c) submit the said data to and in a manner satisfactory to the Environmental Management Division.

5. The Applicant shall dispose of waste sludge produced by the sewage treatment plant in a manner satisfactory to the Environmental Management Division.

Order No. 1175

Dated at the City of Winnipeg
this 25th day of March, 1988.

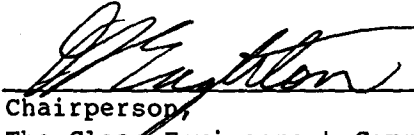

Chairperson,
The Clean Environment Commission.

File: 440.1