



Environment and Climate Change

Environmental Approvals Branch
Box 35, 14 Fultz Boulevard
Winnipeg MB R3Y 0L6
T 204-945-8321 F 204-945-5229
EABDirector@gov.mb.ca

File No.: 4320.10

July 25, 2025

Cameron Prichard
EH&S Manager – Regulatory Compliance
GFL Environmental Services Inc.
4208 84 Ave NW
Edmonton AB T6B 3N5
cprichard@gflenv.com

Dear Cameron Prichard:

Re: GFL Kenaston Hazardous Waste Facility - Dangerous Goods Handling and Transportation Act Licence No. 334 HW - Alteration Approval

Thank you for your alteration request dated March 18, 2025, seeking approval for the installation of a new tank farm and the decommissioning of the existing ones. The proposed new tank farm will consist of 24 aboveground tanks with a total storage capacity of 3,000,000 litres. The existing tank farm to be removed includes 14 aboveground tanks (identified as K1–K12, F1, and F2) with a total capacity of 2,747,000 litres as well as 8 process tanks (P1–P8) with a combined capacity of 300,920 litres. Schedule A of this approval identifies the updated facility layout.

As the proposed alteration does not involve any changes to the existing operational processes at the site, it is not anticipated to cause significant environmental impact. Therefore, I approve your alteration request following clause 109 of The Dangerous Goods Handling and Transportation Act Licence No. 334 HW. As part of this approval, clauses 119 to 129 are hereby added to the licence, and clauses 58 and 59 are rescinded.

In executing the proposed alteration, you must comply with the following conditions:

119. The licensee must not install more than 24 vertical aboveground storage tanks, each with a capacity of 125,000 litres, in the new tank farm identified as Tanks 1 to 24.
120. The licensee must implement the proposed changes to the facility in accordance with the Notice of Alteration dated March 18, 2025, and additional information received on May 22, 2025, June 27, 2025, and July 11, 2025.

121. The licensee must maintain:
 - a) storage tank areas with a containment system that complies with the CCME Environmental Code of Practice (PN 1326) or any future amendments; and
 - b) the secondary containment system in a manner that does not interfere with the net capacity requirements inside the secondary containment system. At no time must the additional precipitation volume impede the secondary containment capacity requirements.

122. The licensee must perform all construction, installation, and operation activities in full compliance with the following applicable regulatory requirements:
 - a) The Dangerous Goods Handling and Transportation Act (C.C.S.M. c. D12);
 - b) The Storage and Handling of Petroleum Products and Allied Products Regulation; and
 - c) National Fire Code (2020), Part 4.

123. The licensee must update the operations manual of the facility as identified in clause 72 of the licence to reflect the proposed alterations.

124. The licensee must update the emergency response contingency plan of the facility as identified in clause 98 of the licence to reflect the proposed alterations.

125. The licensee must, upon completion of tank farm installation and prior to use, submit written confirmation, including photographic documentation and an updated facility layout, to the director.

126. The licensee must maintain the high-level alarms within the storage tanks during the operational condition while transferring product into and from the tanks.

127. The licensee must decommission and remove existing tanks from the following tank farms in accordance with the approved closure plan, as required under clause 111 of the licence:
 - a) main tank farm consisting of 14 aboveground tanks as identified in clause 58 of the licence;
 - b) process tank farm consisting of 4 aboveground tanks as identified in clause 59 of the licence; and
 - c) process tank farm consisting of 4 vertical storage tanks as identified in clause 61 of the licence.

128. The licensee must submit a decommissioning report to the environment officer within 30 days following the removal of the existing main and process tank farms.

129. The licensee must:

- a) prepare record drawings of the facility and must label the drawings “record drawings”; and
- b) submit “record drawings” to the designated environment officer within 120 days of the completion of construction of the new tank farm.

The “record drawings” must include, as a minimum:

- i. the outline of all storage tanks;
- ii. the centerline of all piping or piping groups;
- iii. the centerline of all underground electrical power and monitor sensor conduit;
- iv. building foundation outlines;
- v. secondary containment systems; and
- vi. property lines.

GFL Environmental Inc. must follow all licence requirements and federal, provincial and municipal regulations and by-laws.

This approval is contingent upon your receiving a revised Dangerous Goods Handling and Transportation Act Licence within 90 days from the date of issuance of this letter.

All other clauses of the licence remain in effect. This approval is available on the public registry at <https://manitoba.ca/sd/eal/registries/4320.1gfl/index.html>. Anyone affected by this decision may appeal, in writing, to the Minister of Environment and Climate Change at minecc@manitoba.ca by August 24, 2025.

If you have any questions regarding this approval, please contact Desalegn Edossa, Environmental Engineer, Environmental Approvals Branch at Desalegn.Edossa@gov.mb.ca or 204-945-7021.

For questions relating to the ongoing administration of the licence, please contact Sonja Bridges, Regional Supervisor, Environmental Compliance and Enforcement Branch at EnvCEWinnipeg@gov.mb.ca or 204-918-4271.

Sincerely,

Original Signed By
Agnes Wittmann
Director
The Dangerous Goods
Handling and Transportation Act

c. Sonja Bridges
Desalegn Edossa

Schedule A of July 25, 2025, Approval Letter to the DGHTA Licence No. 334 HW

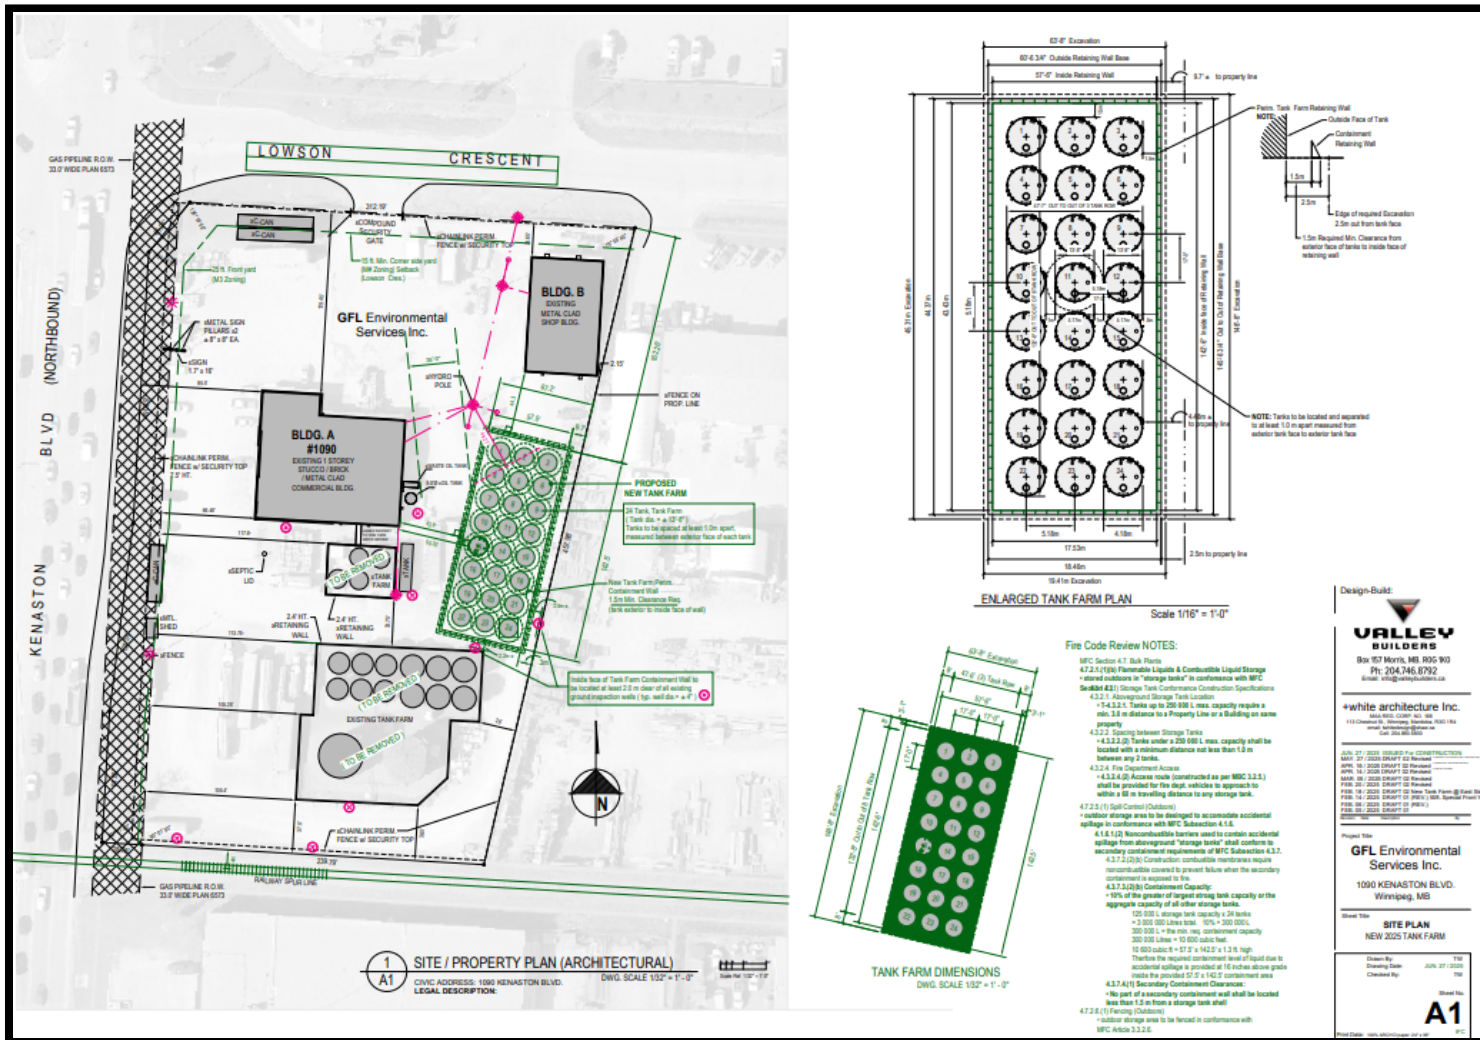


Figure 1 Facility Layout