


### Distance-Drawdown Measurements (@ t = 72 hours)

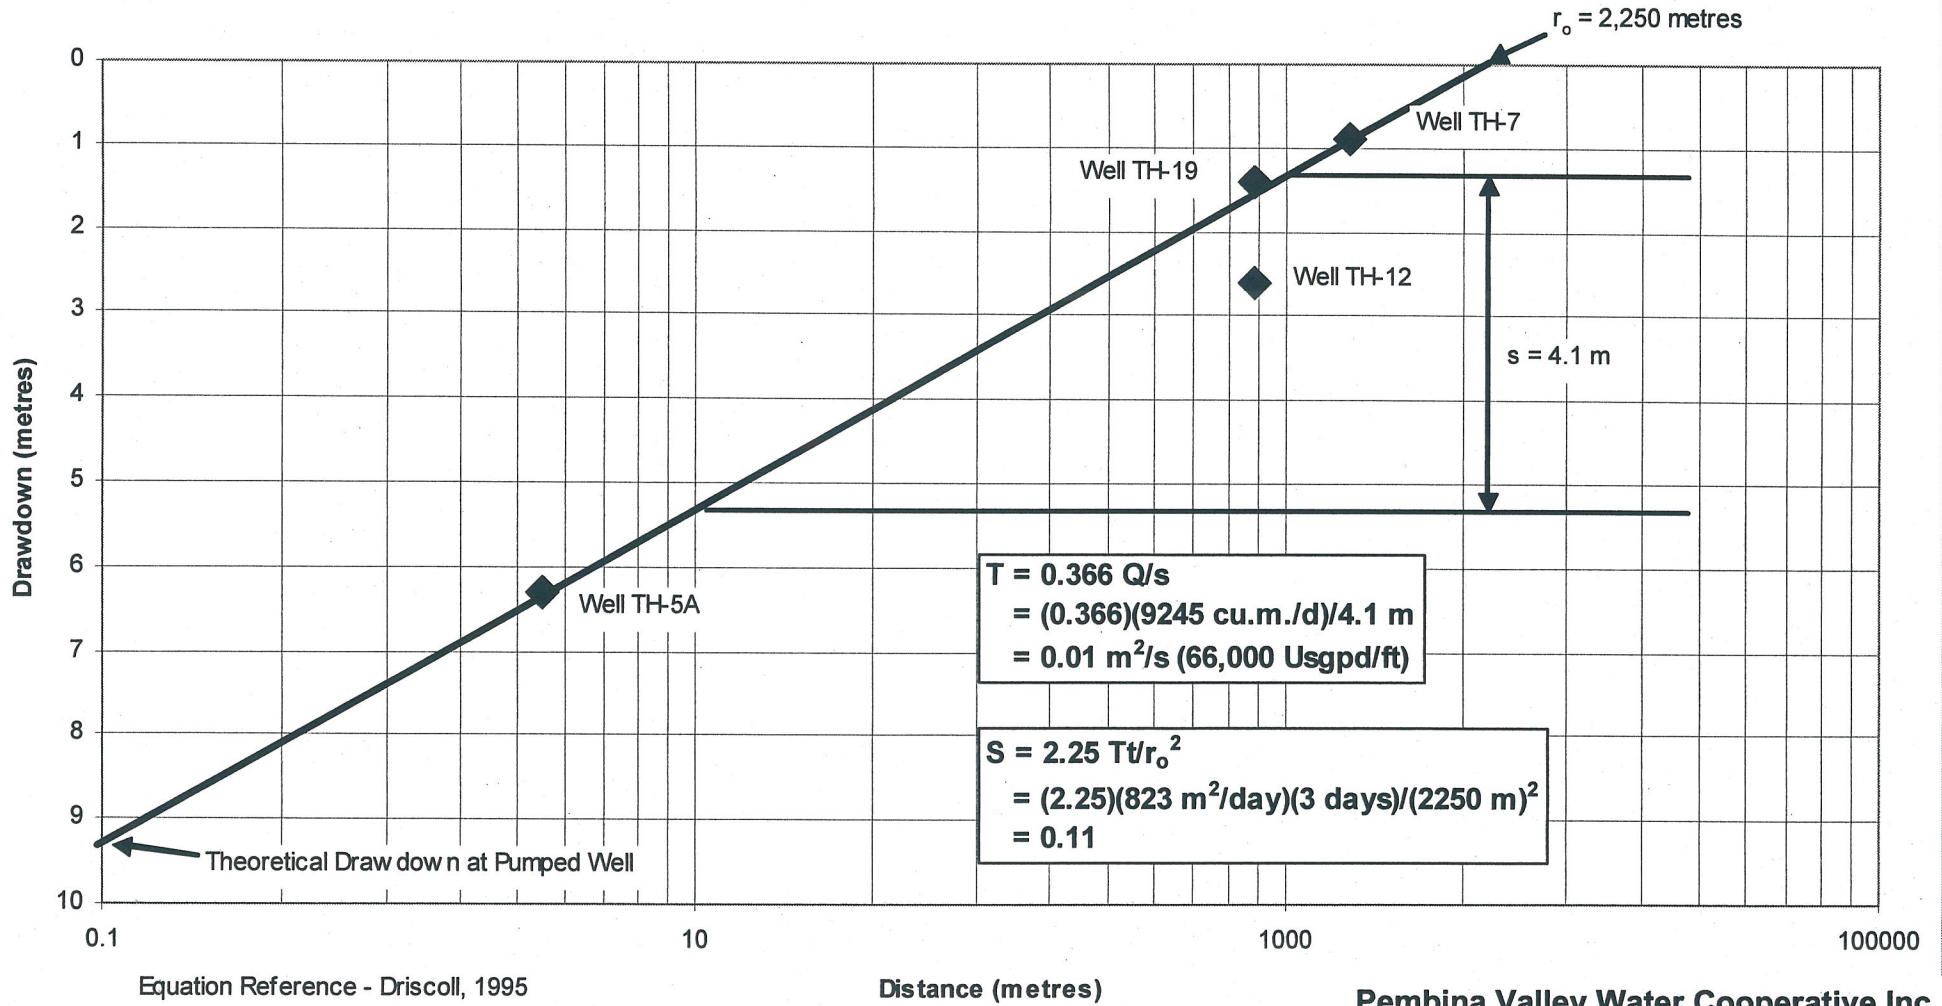

Pembina Valley Water Cooperative Inc.  
Supplemental Groundwater Supply System Evaluation

## Distance Drawdown Measurements

Figure - 17