


Predicted Distance Drawdown Effects

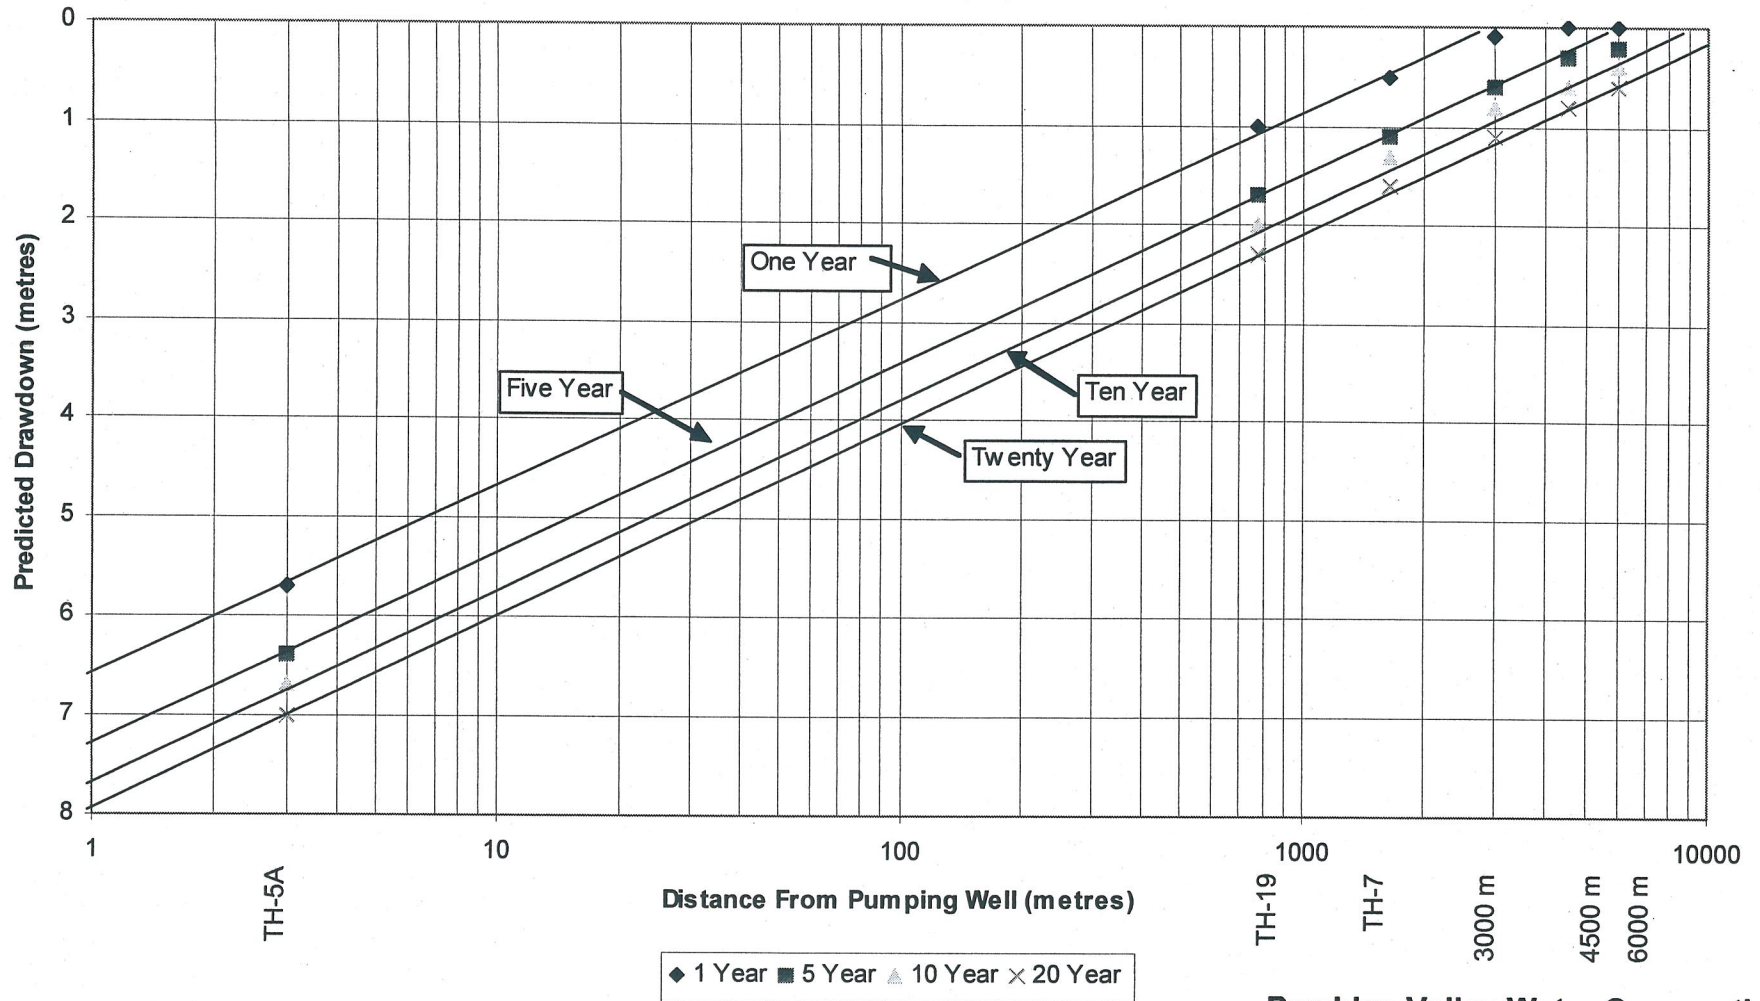

Pembina Valley Water Cooperative Inc.
Supplemental Groundwater Supply System Evaluation

Predicted Distance Drawdown Effects

Figure - 18